


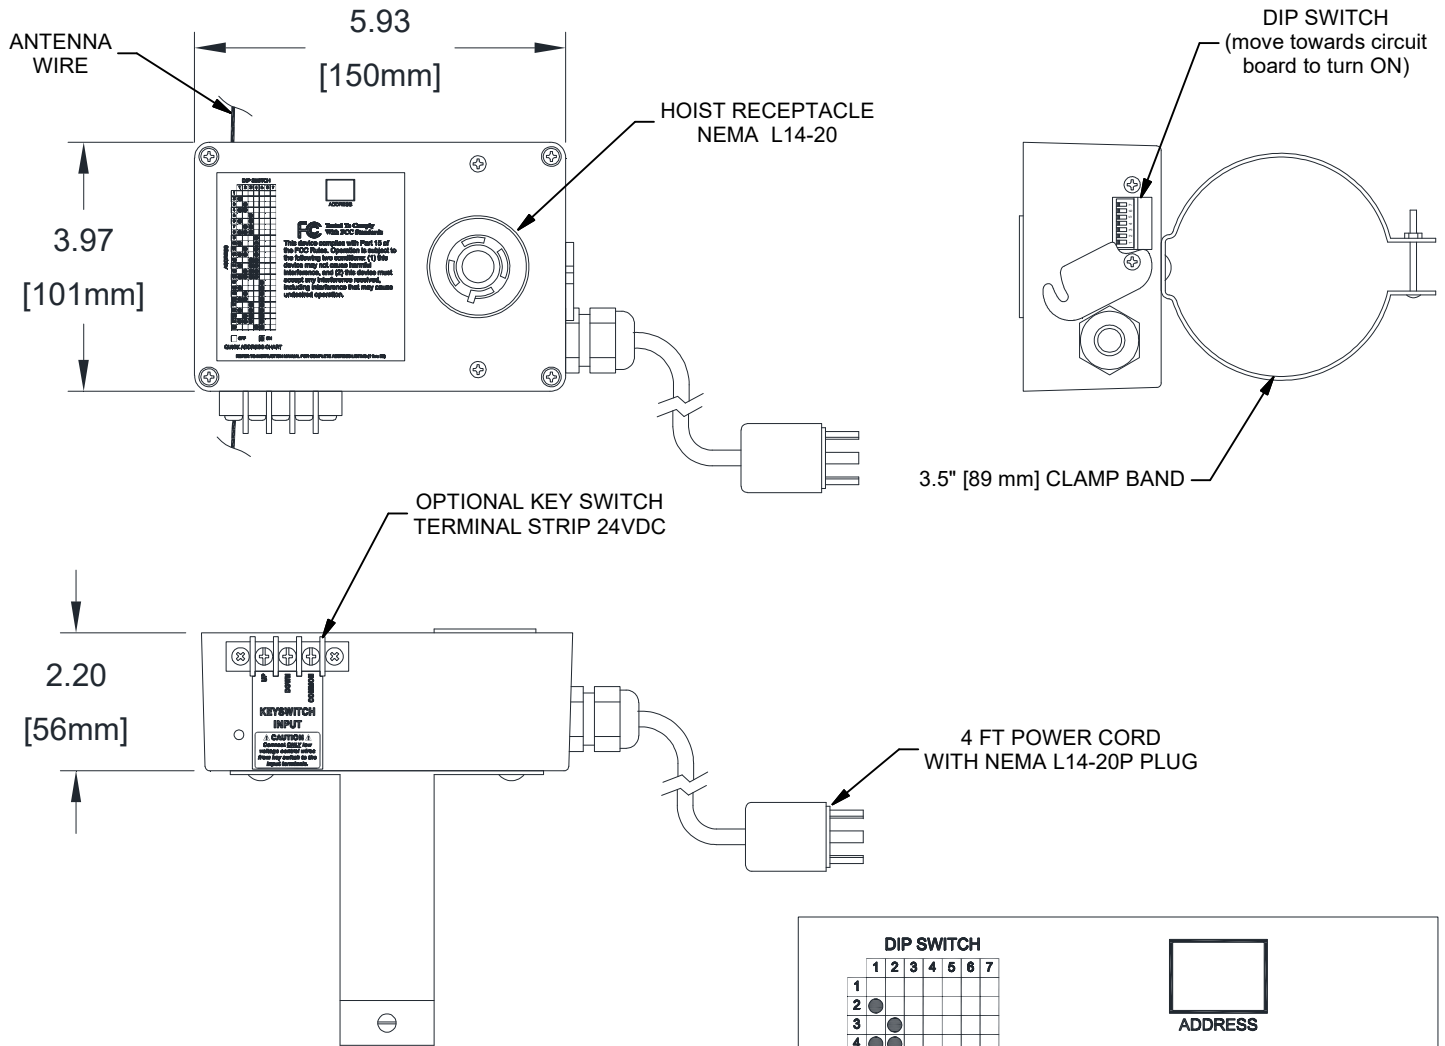

CAUTION

WHEN KEY SWITCH OPTION IS USED, KEY SWITCH MUST BE LOCATED IN AN AREA THAT ALLOWS THE BACKSTOP TO BE VISIBLE TO THE OPERATOR.

ELECTRICAL REQUIREMENTS:

1. UNIT REQUIRES 115 VAC, 20 A, 60 HZ, SINGLE PHASE POWER. LOCATE A L14-20 RECEPTACLE TO MATCH THE POWER SUPPLY CONNECTION WITHIN 5' OF THE UNIT.
2. WHEN KEY SWITCH OPTION IS USED, THE SWITCH WIRING CARRIES 24VDC. **DO NOT CONNECT TO 115VAC POWER SOURCE.**
3. LOCATE KEY SWITCH IN A LOCATION THAT WILL ALLOW THE OPERATOR TO HAVE FULL VIEW OF THE UNIT.
4. UNIT MAY BE USED STAND ALONE WITH MODEL 1198, 99 STATION TRANSMITTER ONLY OR MAY BE USED IN CONJUNCTION WITH LOW VOLTAGE KEY SWITCH AND 99 STATION TRANSMITTER.

REMOTE RECEIVER IS COMPATIBLE WITH 1194 BB HOIST, 4002/4102/4003/4002SF CURTAIN HOIST, AND 1171 ELECTRIC HEIGHT ADJUSTER.

DIP SWITCH		ADDRESS
	1 2 3 4 5 6 7	
1		
2		
3		
4		
5		
6		
7		
8		
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		
21		
22		
23		
24		
25		

☐ OFF ☒ ON

QUICK ADDRESS CHART

REFER TO INSTRUCTION MANUAL FOR COMPLETE ADDRESS LISTING (1 thru 99)



Tested To Comply With FCC Standards

This device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.



Gared Performance Sports Systems
9200 East 146th Street, Suite A
Noblesville, IN 46060

THIS DOCUMENT CONTAINS TRADE SECRET AND OTHER MATERIALS WHICH ARE PROTECTED BY CONFIDENTIALITY NOTICE AND AGREEMENT AND BY COPYRIGHT. ANY USE OR COPYING OF THIS DOCUMENT EXCEPT AS AUTHORIZED BY GARED PERFORMANCE SPORTS SYSTEMS IS STRICTLY PROHIBITED.

REMOTE CONTROL RECEIVER, 115V

DRAWN CROSBY		DATE 4/15/2020		DATE ISSUED	
APPROVED		DATE			
SIZE A	SCALE	SHT. NO. 1 OF 3	PART NO. 1199	REV E	

E	ERD	08-17-23
D	WDC	04-15-20
REV	BY	DATE



MODEL 1199

WIRELESS REMOTE CONTROL RECEIVER, 115 VAC

APPLICATION

This unit designed to operate Model 1194 basketball hoist, Model 4002/4102/4003/4003SF curtain hoists, or Models 1171 electric height adjuster by wireless remote control. This unit eliminates the need to run wiring for individual key switches.

Each hoist shall be equipped with a commercial receiver that can be coded for individual operation. Receiver shall be factory wired and attached to a metal enclosure that has a 3-1/2" pipe clamp for attachment to the overhead superstructure. Unit to have 4' power cord with a L14-20 twist-lock grounded plug attached. Matching receptacle, 4" cover, and junction box to be supplied by others.






Wireless remote control operator can be used with key switch operation when required. Key switch may be included with certain hoist units or it can be ordered separately.

Wireless remote control requires (1) model 1198 battery powered (standard 9-volt) hand held transmitter capable of operating up to ninety nine individual hoists. Transmitter sold separately. Additional transmitters are available to match facility requirements.

All other electrical, junction and synchronizer boxes not mentioned above shall be furnished and installed by a certified electrical contractor. Follow manufacturer's instructions and all local safety codes.

OPTIONAL EQUIPMENT

- 1198 REMOTE TRANSMITTER, 99 STATION, 9VDC
- 1195-01-00 KEYSWITCH W/COVER, SINGLE

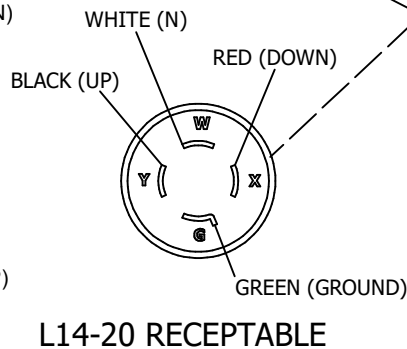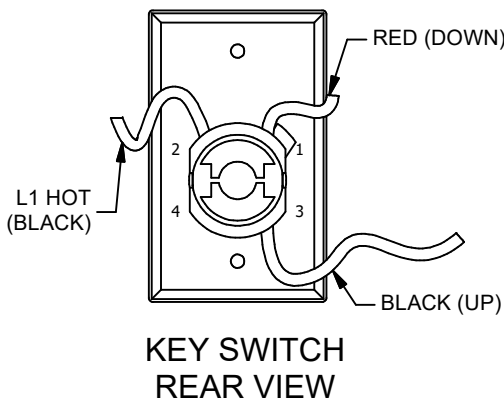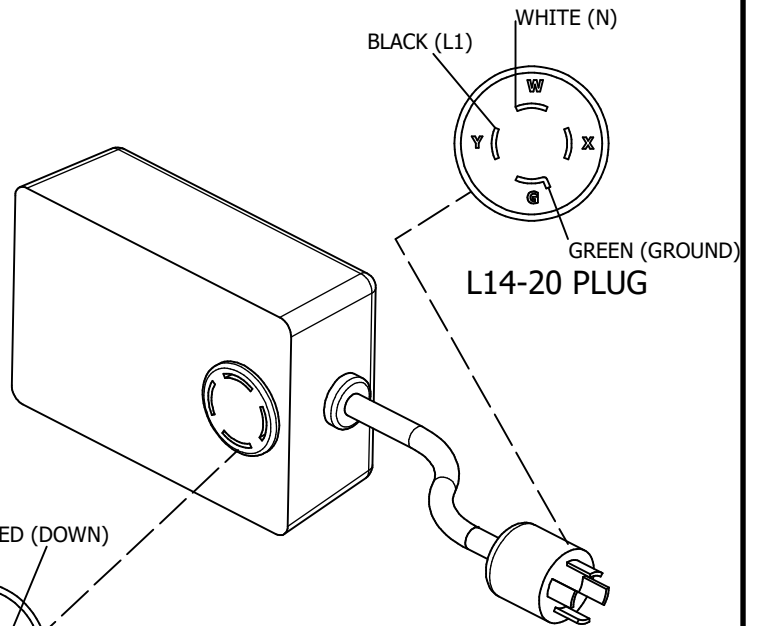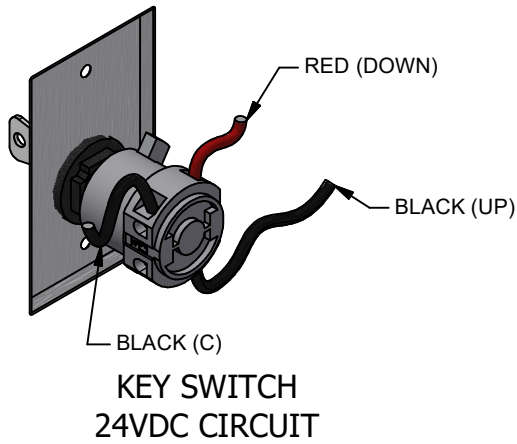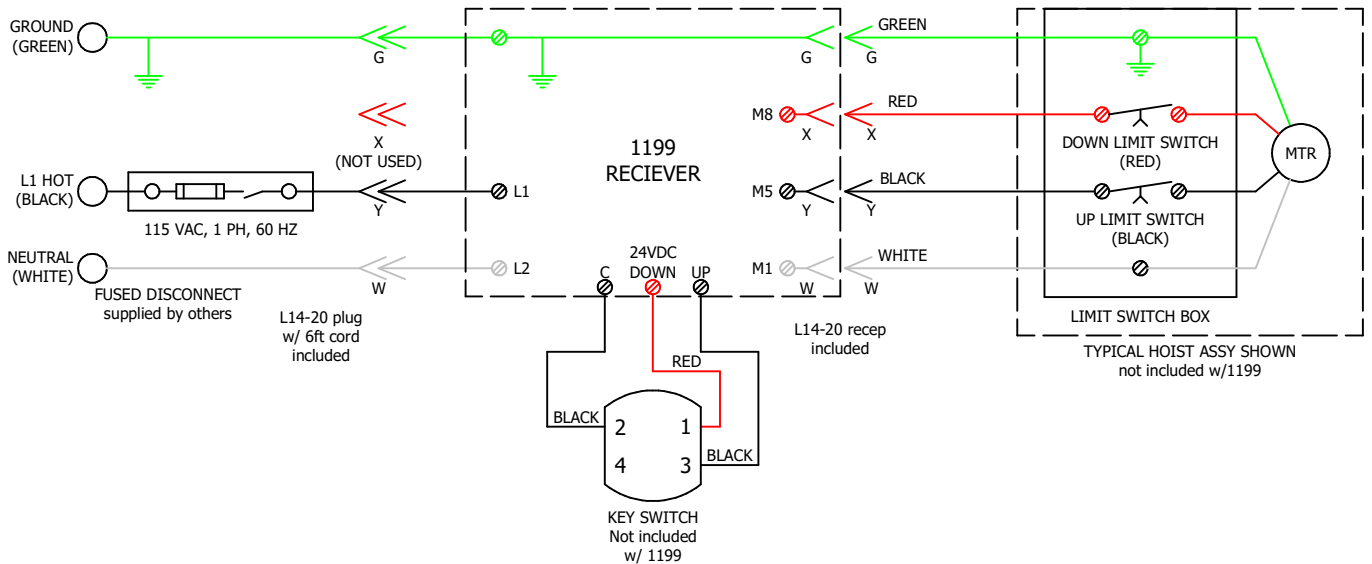

**GARED PERFORMANCE
SPORTS SYSTEMS**

Gared Performance Sports Systems
9200 East 146th Street, Suite A
Noblesville, IN 46060

THIS DOCUMENT CONTAINS TRADE SECRET AND OTHER MATERIALS WHICH ARE PROTECTED BY CONFIDENTIALITY NOTICE AND AGREEMENT AND BY COPYRIGHT. ANY USE OR COPYING OF THIS DOCUMENT EXCEPT AS AUTHORIZED BY GARED PERFORMANCE SPORTS SYSTEMS IS STRICTLY PROHIBITED.

REMOTE CONTROL RECEIVER, 115V

DRAWN CROSBY		DATE 4/15/2020		DATE ISSUED	
APPROVED		DATE			
SIZE A	SCALE	SHT. NO. 3 OF 3	PART NO. 1199	REV E	

E	ERD	08-17-23
D	WDC	04-15-20
REV	BY	DATE